


N001	TYPICAL DRIVEN GROUND ROD ALONG THE BUILDING PERIMETER FOR LIGHTNING PROTECTION SYSTEM.
N002	FOR CONNECTION TO LIGHTNING PROTECTION DOWN CONDUCTOR.
N003	TYPICAL GROUND TEST WELL.



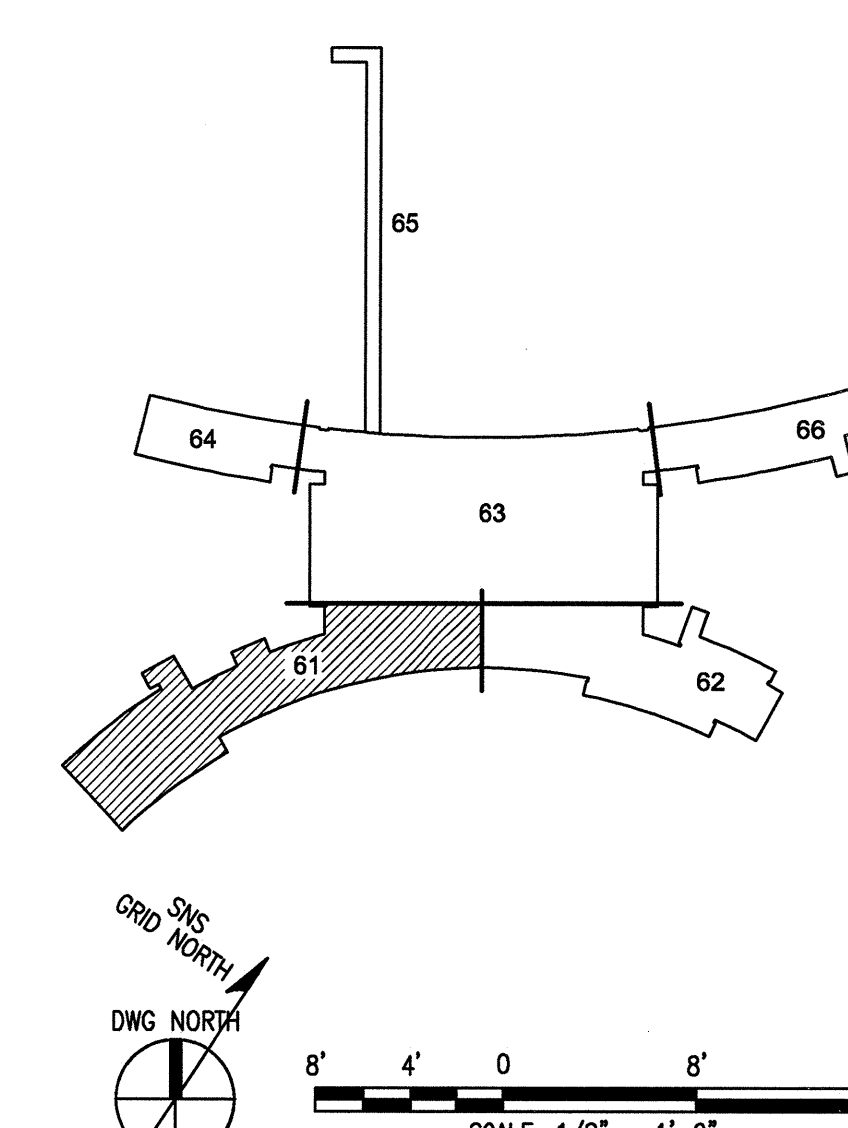

Knight/Jacobs Joint Venture  
701 Southern Blvd. MS E253  
Oak Ridge, TN 37830

865-241-5433  
fax 865-241-3400

# KNIGHT

Knight Advanced Technology

C/O Oak Ridge K-25  
Phone: 615 5500



Oak Ridge National Laboratory  
managed for the DEPARTMENT OF ENERGY under  
U.S. GOVERNMENT CONTRACT DE-AC05-00OR22725

UT-BATTELLE, LLC • Oak Ridge, Tennessee

PROJECT NAME:

## SPALLATION NEUTRON SOURCE

## CENTRAL LAB AND OFFICE BUILDING

## GROUNDING PLAN

## LEVEL B1, SECTOR 61



[illegible]

NUMBER OF SECTION OR DETAIL

DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

SECTION AND DETAIL KEY

THIS DOCUMENT  
CONTROLLED BY

CHANGE CONTROL  
SYSTEM 4

ENGINEERING  
PROCEDURE SNS-ENG-